


CORED OPENINGS SHALL BE BEVELLED TO ALLOW FOR MIS-ALIGNMENT.
 FLEXIBLE SLEEVE SHALL BE NEOPRENE MATERIAL MEETING ASTN C-443.
 VOIDS BETWEEN GASKET AND STRUCTURE SHALL BE FILLED USING TYPE
 N MORTAR AND FINISHED SMOOTH.

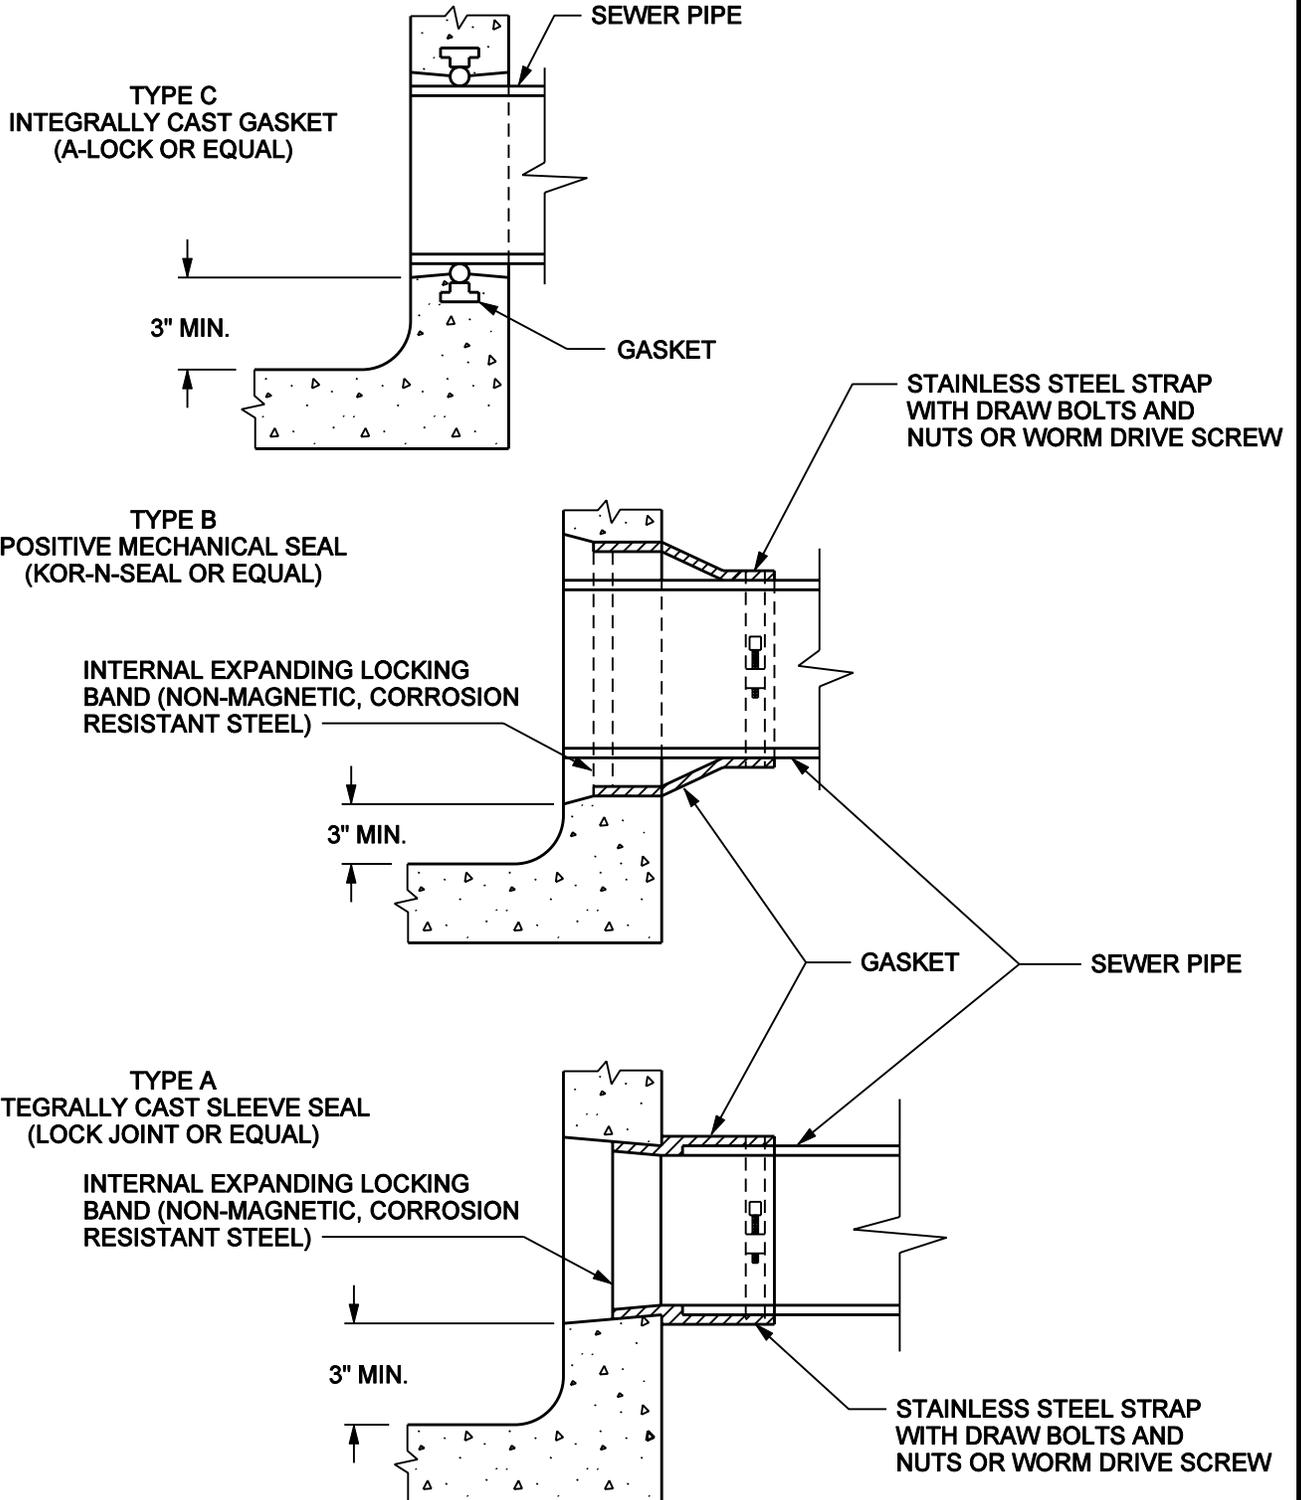

MNDOT SPEC. REF. 2503, 2506
 MNDOT 4007C
 NOT TO SCALE

	MINNEAPOLIS DEPARTMENT OF PUBLIC WORKS		WATERTIGHT PIPE CONNECTION	STANDARD PLATE NO. SEWR-3001
	DRAWN: DCD	DATE: 3/03		
	APPROVED: HRS	DATE: 12/06		